Tes

T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690 Model No.

EC-3102

Item No.

NSF 61 - Section 9 NSF 372 (Low Lead Content)

1:6

Sheet: 1 of 2


ANSI A117.1 (ADA)

Scale:

UL 1951

09/10/18

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

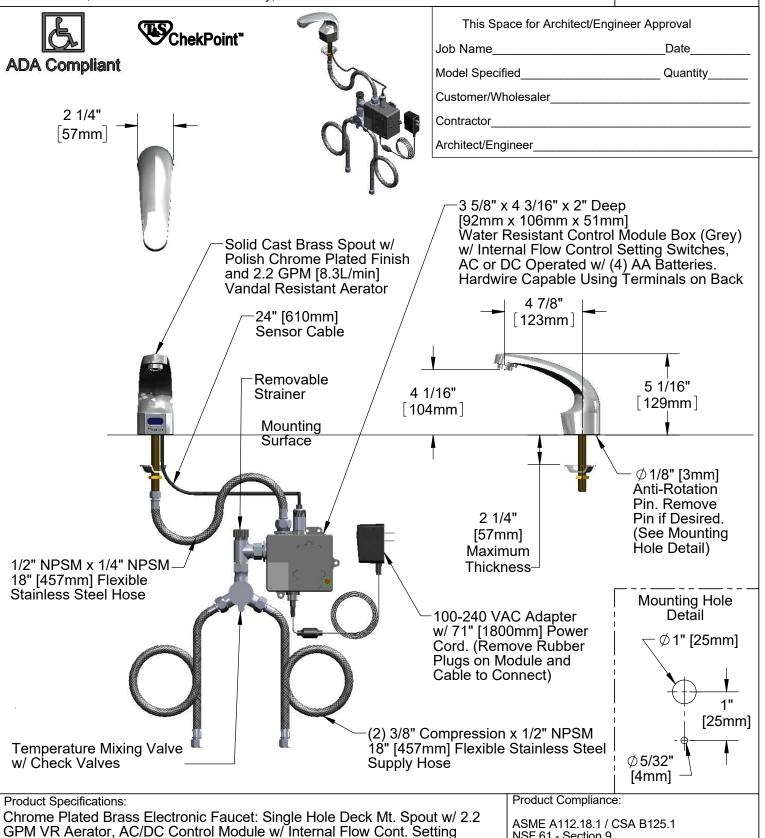

Switches, Temperature Cont. Mixing Valve w/ Check Valves, 18" Hot & Cold

Approved:

JHB

Date:

JRM

Supply Stop Flexible Connector Hoses

Checked:

AMG

Drawn:



T&S BRASS AND BRONZE WORKS, INC.

2 Saddleback Cove / P.O. Box 1088 Travelers Rest, SC 29690


Model No.


EC-3102

Item No.

Travelers Rest, SC: 800-476-4103 • Simi Valley, CA: 800-423-0150 • Fax: 864-834-3518 • www.tsbrass.com

ITEM NO.	SALES NO.	DESCRIPTION						
1	B-0199-08	VR 2.2 GPM Aerator, 13/16-27 UN Male w/ Key						
2	017195-45	Angled Sensor w/ Cable						
3	016297-45	Inlet Hose, Faucet, 1/2" NPSM-F x 1/4" NPSM-F						
4	016647-45	ChekPoint Module (Grey)						
5	5EF-0002	Plug-In AC Transformer						
6	5EF-0006	Mechanical Mixing Valve						
7	5EF-0005	Supply Hose, 9/16-24 Female x 1/2" NPSM						
8	015425-45	Vandal Resistant Key						
9	EC-FILTER	Replacement Filter						

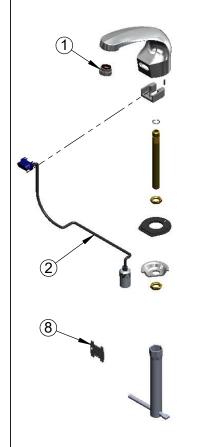

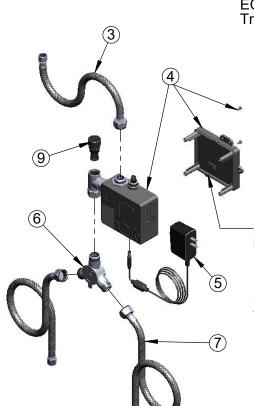

A Maximum of (8) ChekPoint Faucets can be Hardwire Connected and Powered by EC-HARDWIRE ChekPoint Hardwire AC Transformer. (Sold Separately)

Label for Flow Control Switch Settings is Located on Inside of Back Cover.

Flow Control Switches are Located Inside Module Housing in Black Box Next to Battery Compartment.

- *Switches are Set to DEFAULT Position:
 - Auto Time Out = 15 Seconds
 - Shut Off Delay = 1 Second
 - Auto Flush = ÓFF

Remove (4) Screws and Back Cover to Access Switches.

*Available Water Flow Control Selections:

- Auto Time Out: 15 sec, 30 sec, 45 sec, 60 sec, 3 min, 20 min Shut Off Delay: 1 sec, 10 sec, 15 sec, 30 sec
- Auto Flush (30 Seconds After Every 12 Inactive Hours): ON or OFF

Product Specifications:

Chrome Plated Brass Electronic Faucet: Single Hole Deck Mt. Spout w/ 2.2 GPM VR Aerator, AC/DC Control Module w/ Internal Flow Cont. Setting Switches, Temperature Cont. Mixing Valve w/ Check Valves, 18" Hot & Cold Supply Stop Flexible Connector Hoses

Product Compliance:

ASME A112.18.1 / CSA B125.1 NSF 61 - Section 9 NSF 372 (Low Lead Content) ANSI A117.1 (ADA) UL 1951

Drawn:	AMG	Checked:	JRM	Approved:	JHB	Date:	09/10/18	Scale:	NTS	Sheet: 2 of 2